



**INTEGRITY METALS**  
Architectural Fabrication

# FLORIDA PRODUCT APPROVAL

## FL 29444.05 – R3

### IM 75COR

26ga (min) 3/4" corrugated exposed fastener panel over 15/32" (min) plywood



**Product Description:** Exposed fastener corrugated panel with a 29.5" coverage and a nominal trough-peak height of 0.75".

**Product Material:** 26ga steel (min). Corrosion resistant per FBC 1507.4.3 where required.

**Fastener:** #9 x 2-inch fastener with sealing washer. Compliant with FBC 1506.6 where required. Larger diameter and longer length fasteners are acceptable. Stainless fasteners are acceptable.

**Substrate/Deck:** 2x4 (nom) battens. Battens perpendicular to panel at 24" (max) and attached to roof joists (max 24" oc joists) with (2) #8x3" wood screws


#### Maximum Allowable Loads & Installation Requirements:

Method	Fastener Pattern	Fastener Spacing	Allowable Pressure
Method A	#9 x 2" fasteners in 6"-6" pattern (every other peak)	24" o.c	-101 PSF
Method B	#9 x 2" fasteners in 3"-3" pattern (every peak)	24" o.c.	-161 PSF

Fasteners are installed into 2x4 (nom) battens. Battens are attached to roof joists with (2) #8 x 3" wood screws. Battens are at 24" oc (max) and roof joists at 24" oc (max). The #8 x 3" must directly penetrate the roof joists. A factor of safety of 2 has been applied.

METHOD A: EVERY OTHER RIDGE, 24" O.C.

METHOD B: EVERY RIDGE, 24" O.C.

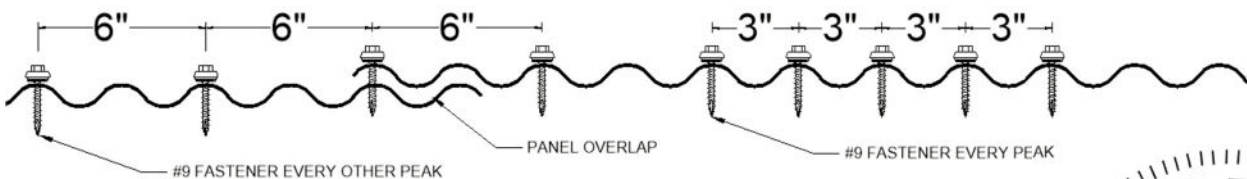


#### EVALUATED BY:

**David Eng, PE**  
Timberlake Cove, LLC  
FL PE 81377 • FL CA 33344  
1317 Edgewater Dr Ste 2339  
Orlando FL  
timberlakecove.com

Digitally signed by  
David E Eng  
Date: 2023.09.05  
19:31:56-04'00'

This item has been digitally signed and sealed by David Eng, PE on the date indicated. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

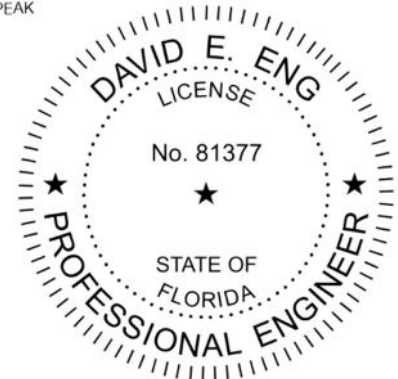



**Underlayment:** Comply with local building code or FBC 1507.1.1 where required.

**Slope:** Comply with local building code or FBC 1507.4.2 where required. FBC 1507.4.2 minimum slope is ½:12 with lap sealant, or 3:12 without lap sealant

**Re-Roofing:** This panel may be installed over a single layer of existing shingles as permitted by local building code or FBC 1511, provided the existing roof meets the conditions required by the applicable code.

**Panel Accessories:** The manufacturer does not require the use of closures, sealants, butyl, or other similar accessories between bottom edge of panel and drip edge, or in other locations. The use of closures and sealants may be advisable in some cases, however that decision is the discretion of the project owner and the installer.

**Technical Documentation:** This product has been tested to the UL 580 standard by Intertek Testing (TST-1527), report K2132.08-450-44 R0 as referenced in FL30780.5 R0. Tests used with permission.

**Compliance Statement:** This product as described has demonstrated compliance with Florida Building Code 2023, 1504.3.2 (**non-HVHZ**) as required by FL Rule 61G20-3, method 1D.

This product as described has been tested and demonstrated compliance with:

- UL580 – Test for Uplift Resistance of Roof Assemblies
- UL 1897 – Uplift test for roof covering systems

**Design Process:** Compare the maximum allowable loads on page 1 to the ASD uplift pressures for the project to determine sufficiency and installation requirements. Determine project uplift pressures using ASCE 7-22, FBC R301, project design documents, guidance from local building department, or other design professionals. Engineering analysis may be completed by other licensed engineers for project specific approval by local authorities having jurisdiction.

**Notice to Other Entities:** This product approval applies only to metal panel products produced by Integrity Metals. Without a valid purchase order from Integrity Metals as documentation, this product approval shall not be used to demonstrate compliance for any project. Integrity Metals assumes no liability for non-compliance or product performance for any product relying on this approval but not manufactured by Integrity Metals. Other manufacturers, distributors, installers, engineers, architects, or other parties relying on this approval for any product not produced by Integrity Metals assume full, strict product liability. Traceability of coil, audited quality assurance programs, and compliance with FAC 61G20-3 are solely the responsibility of the entity relying on this approval for any product not produced by Integrity Metals.

**CERTIFICATION OF INDEPENDENCE:** David Eng, PE and Timberlake Cove, LLC do not have, nor will acquire a financial interest in any company manufacturing or distributing products under this evaluation. The same entities do not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

**EXCLUSIONS AND LIMITATIONS:** Design of deck and roof structure (to include attachment of plywood or wood plank) shall be completed by others. Fire classification and shear diaphragm design are outside the scope of this evaluation. Accelerated weathering/salt spray is outside the scope of this evaluation.

This report is limited to compliance with structural wind load requirements of FBC 1504.3.2, as required by Rule 61G20-3. Neither Timberlake Cove nor the manufacturer shall be responsible for any conclusions, interpretations, or designs made by others based on this evaluation report. This report is limited solely to documenting compliance with Rule 61G20-3, and makes no express or implied warranty regarding performance of this product. Installation shall be subject to the local building code and authority having jurisdiction; this report shall not be construed to supersede local codes in force.

